


DIAPHRAGM TEST USING TECTUM E ROOF PLANK 5" ON 2-1/2" WOOD PURLINS AT 96" O.C. SCREWED 8" O.C. PERIMETER AND 12" O.C. FIELD WITH CONSTRUCTION ADHESIVE ON BEARINGS AND ALONG THE TONGE AND GROOVE. OVERLAYMENT IS 7/16" OSB MEETING PS-2-10. OSB IS ATTACHED USING 2" LONG, 1/2" WIDE 16 GAUGE STAPLES AT 4" O.C. AT THE PERIMETER OF THE OSB PANEL AND 8" O.C. IN THE FIELD AT 24" INTERVALS FROM THE ENDS. A 3/8" BEAD OF CONSTRUCTION ADHESIVE IS USED BETWEEN THE LAYERS WITH THE LOCATION CORRESPONDING TO THE STAPLE LINES.

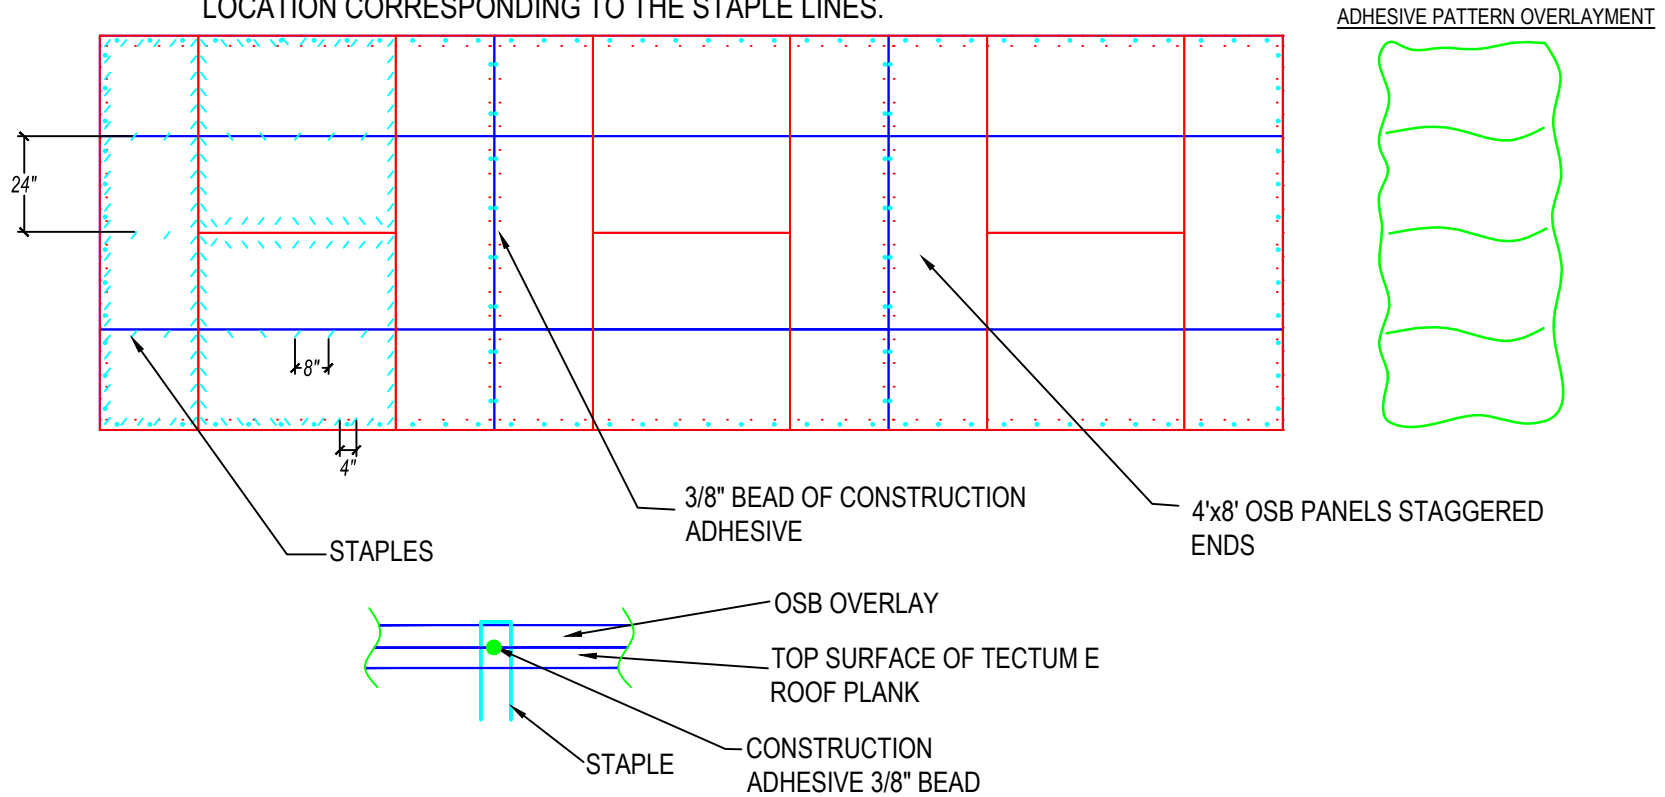

1 TECTUM V - OVERLAYMENT FOR DIAPHRAGM
Scale: N.T.S.

These drawings show typical conditions in which the Armstrong product depicted is installed. They are not a substitute for an architect's or engineer's plan and do not reflect the unique requirements of local building codes, laws, statutes, ordinances, rules and regulations (Legal Requirements) that may be applicable for a particular installation. Armstrong does not warrant, and assumes no liability for the accuracy or completeness of the drawings for a particular installation or their fitness for a particular purpose. The user is advised to consult with a duly licensed architect or engineer in the particular locale of the installation to assure compliance with all Legal Requirements. Armstrong is not licensed to provide professional architecture or engineering design services.

PROJECT NAME: TECTUM V - OVERLAYMENT FOR DIAPHRAGM		
DATE: 10-30-17	SCALE: N.T.S.	PROJECT NO.: XXX
REV:	DATE:	DESC.: 2062 - TECTUM V - OVERLAYMENT FOR DIAPHRAGM
REV:	DATE:	

Armstrong [®] CEILING & WALL SOLUTIONS	
DRAWN BY: KBD	PROJECT MNGR: XXX
SHEET SK1 1 OF 1	