


FOR ROOF PLANK, ANY OPENING WITHIN 4" OF THE LONG EDGE MUST HAVE SUPPLEMENTARY SUPPORT.

END JOINTS MUST FALL OVER SUPPORTING MEMBERS. MINIMUM BEARING IS ONE INCH.

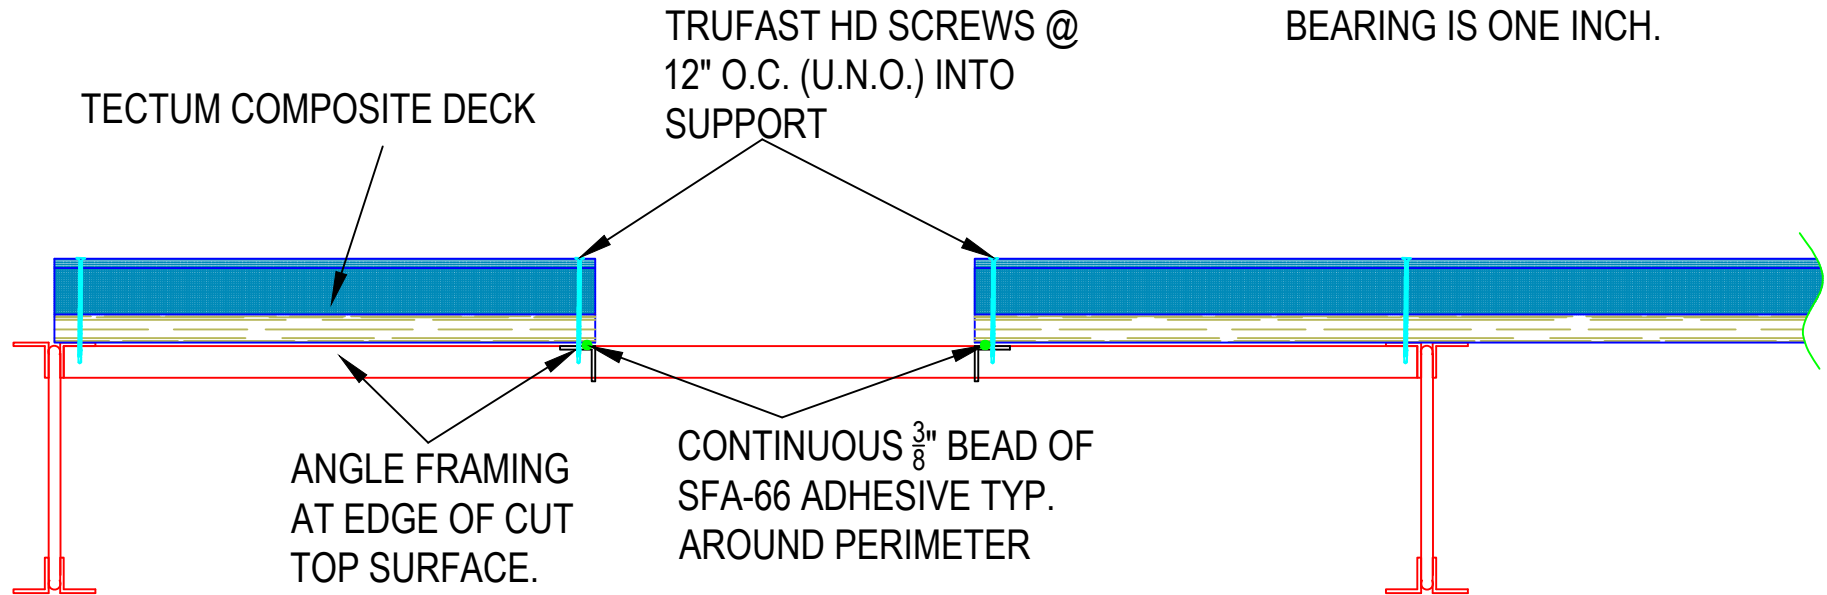

DETAIL OF TECTUM PLANK OVER BAR JOIST. SUPPLEMENTARY FRAMING REQUIRED FOR OPENINGS GREATER THAN 8" IN ANY DIRECTION. SCREW ATTACH PANELS TO THE FRAMING FOR THE OPENING. SPACING DEPENDANT ON UPLIFT AND DIAPHRAGM REQUIREMENTS.

1 TECTUM PLANK OPENING OVER STEEL DETAIL - COMPOSITE
Scale: N.T.S.

These drawings show typical conditions in which the Armstrong product depicted is installed. They are not a substitute for an architect's or engineer's plan and do not reflect the unique requirements of local building codes, laws, statutes, ordinances, rules and regulations (Legal Requirements) that may be applicable for a particular installation. Armstrong does not warrant, and assumes no liability for the accuracy or completeness of the drawings for a particular installation or their fitness for a particular purpose. The user is advised to consult with a duly licensed architect or engineer in the particular locale of the installation to assure compliance with all Legal Requirements. Armstrong is not licensed to provide professional architecture or engineering design services.

PROJECT NAME: TECTUM PLANK OPENING OVER STEEL DETAIL - COMPOSITE		
DATE: 10-30-17	SCALE: N.T.S.	PROJECT NO.: XXX
REV:	DATE:	DESC.: 2065 - TECTUM PLANK OPENING OVER STEEL DETAIL - COMPOSITE
REV:	DATE:	



DRAWN BY: KBD	PROJECT MNGR: XXX	SHEET
		SK1
		1 OF 1